
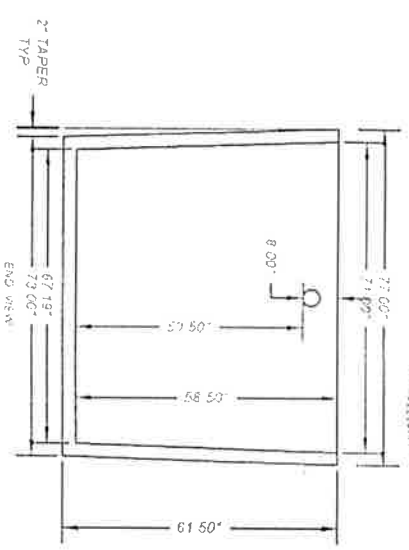
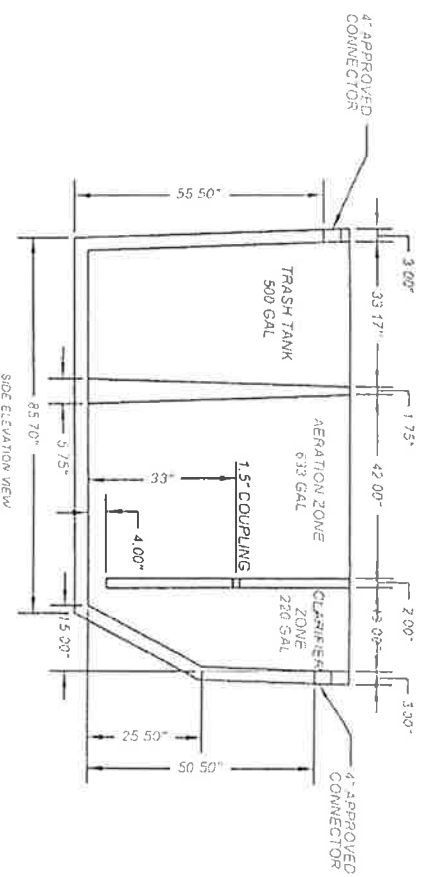


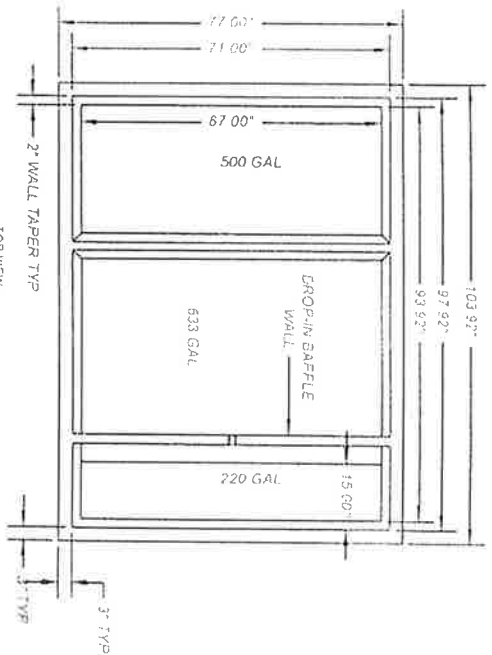

TANK CATEGORY 3, 3" 750 GPD AQUAKLEAR TANK 3 COMPARTMENT TANK, 3" WALL AND 3" SOTTOK, INLET AND OUTLET RESILIENT CONNECTORS PER ASTM C-923/C-923M-20. CONNECTORS MUST BE USED WITH APPROVED CLAMP. CONNECTOR WILL ACCEPT 4" PVC PIPE. AIR LINES PASS THROUGH POLYLOCK RISERS IN LID.

MINIMUM 4000 PSI CONCRETE AT 28 DAYS. REINFORCED WITH BARCHIP 48 POLYPROPYLENE FIBER.


IMPRINTED ON INLET END OF TANK.

LEGEND FS1750 STATE APPROVAL NUMBER 01-2114K7-55245-C3 EFFECTIVE CAPACITY 1353 GALLONS

TANK WEIGHT: TANK ONLY 8,675 LBS

THIS SEWAGE TREATMENT RECEPTACLE HAS BEEN DESIGNED, CONSTRUCTED AND STRUCTURALLY TESTED IN ACCORDANCE WITH CHAPTER 62-6.013, FLORIDA ADMINISTRATIVE CODE (FAC), DATED DECEMBER 31, 2023.


AIR SPACE AT 8" = 240 GALLONS




Digitally signed
by Gary G
Dounson
Date: 2025.03.25
13:25:33 -04'00'

FLORIDA SEPTIC, INC.
P.O. BOX 545
HAWTHORNE, FLORIDA 32640
(800) 940-8265

MODEL: 3" 750 AQUAKLEAR TANK
REVISED: APPROVAL DATE:

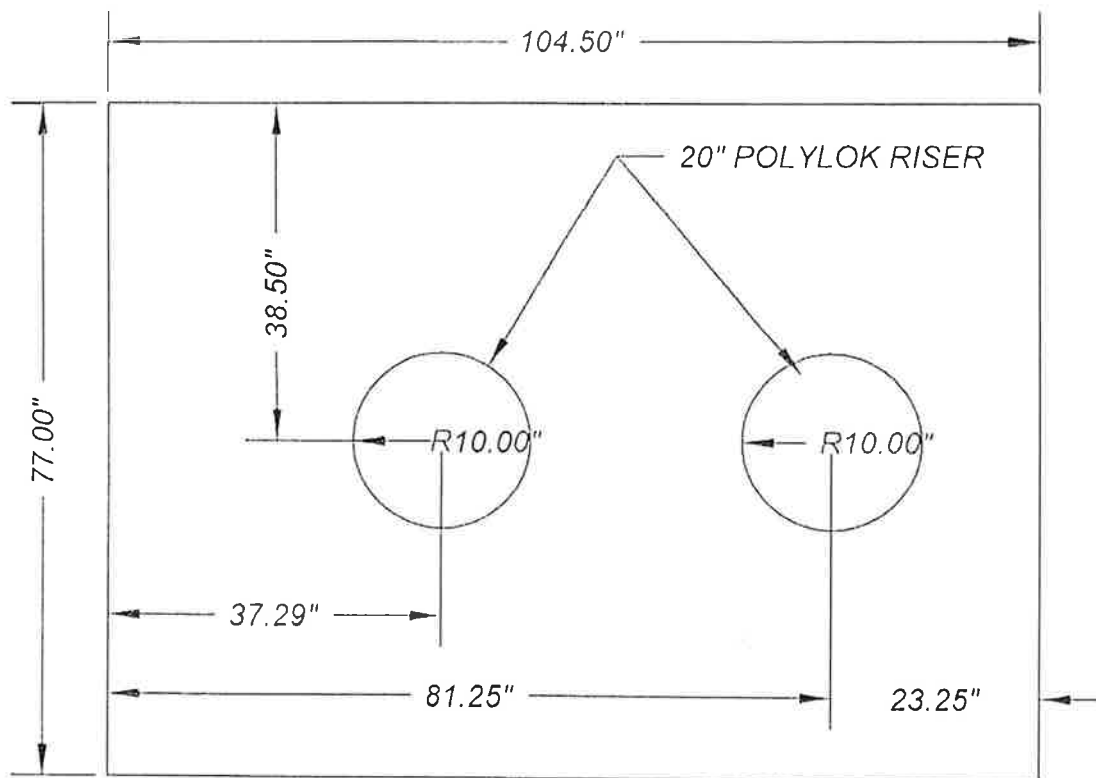

LID TOP VIEW

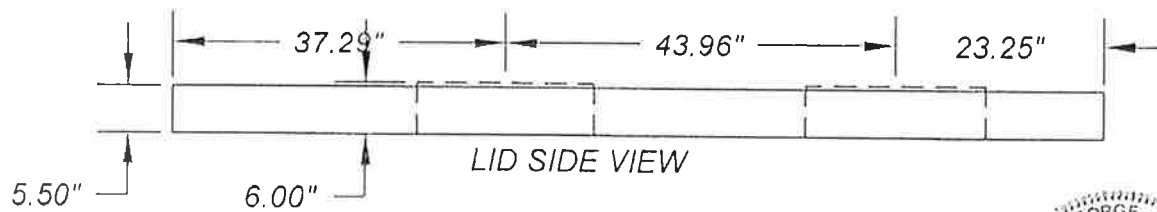

LID SIDE VIEW

4" STANDARD LID CONSTRUCTED WITH A MINIMUM 5500 PSI CONCRETE AT 28 DAYS REINFORCED WITH TWO MATTS OF #4 REBARS TRANSVERSE AND LONGITUDINAL PLACED IN TOP AND BOTTOM OF SLAB.

LID HAS TWO 20" DIAMETER MANHOLES WITH 20" DIAMETER CAST-IN-PLACE POLYLOK RISERS AS SHOWN.

LID WEIGHT: 3,391 LBS WITH PLUGS INCLUDED.

MAXIMUM FILL OVER LID LIMITED TO 30".

DESIGNED TO MEET REQUIREMENTS OF FAC 62-6.013.



Digitally signed by
Gary G Dounson
Date: 2025.03.25
13:26:41 -04'00'

FLORIDA SEPTIC, INC.
P.O. BOX 545
HAWTHORNE, FLORIDA 32640
(800) 940-8265

MODEL: 5.5" STANDARD TANK LID FOR
3" 750 AQUAKLEAR TANK

REVISED:

APPROVAL DATE: